


\*NOTE\*  
ALTHOUGH EVERY EFFORT HAS  
BEEN MADE IN PREPARING THESE  
PLANS AND CHECKING THEM FOR  
ACCURACY, THE CONTRACTOR  
MUST CHECK ALL DETAILS AND  
DIMENSIONS AND BE RESPONSIBLE  
FOR THE SAME.

NOTE:  
-ALL EXTERIOR HOUSE WALLS ARE 2x6 WITH 7/16"  
SHEATHING, DIMENSIONED AS 6".  
-ALL INTERIOR WALLS ARE 2x4, DIMENSIONED AS  
3 1/2". (UNLESS NOTED OTHERWISE)  
-ALL WINDOW HEADERS TO BE 2-2x12 D.F.  
(UNLESS NOTED OTHERWISE)  
SPECIFICATIONS  
-TOTAL NUMBER OF SILL PLATES= 1  
-2ND FLOOR JOISTS = 9 1/2" I-JOISTS @ 16" O.C.  
-FLOOR SHEATHING = 3/4"  
-EXTERIOR WALLS  
MAIN= 2x6x8-1 1/8" @ 16" O.C.  
GARAGE= N/A  
LOWER = N/A  
-EXTERIOR WALL SHEATHING = 7/16" O.S.B.  
-HOUSEWRAP= TYVEK  
-ROOF FRAMING= TRUSSES @ 24" O.C. (1" HEELS)  
-ROOF SHEATHING= 1/2" O.S.B.  
-ROOF FELT= 15# FELT  
-ROOF INSULATION= R-50  
-WINDOWS= VINYL SINGLE HUNG  
-EXTERIOR DOORS= STEEL THERMA-TRU OR EQUIV.  
SKYLIGHTS= N/A  
-FIREPLACE= N/A  
-HOUSE VENTILATION SYSTEM= TO BE  
BY THE CONTRACTOR.  
-TOP OF WINDOW ROUGH OPENING = 6'-10 7/8".

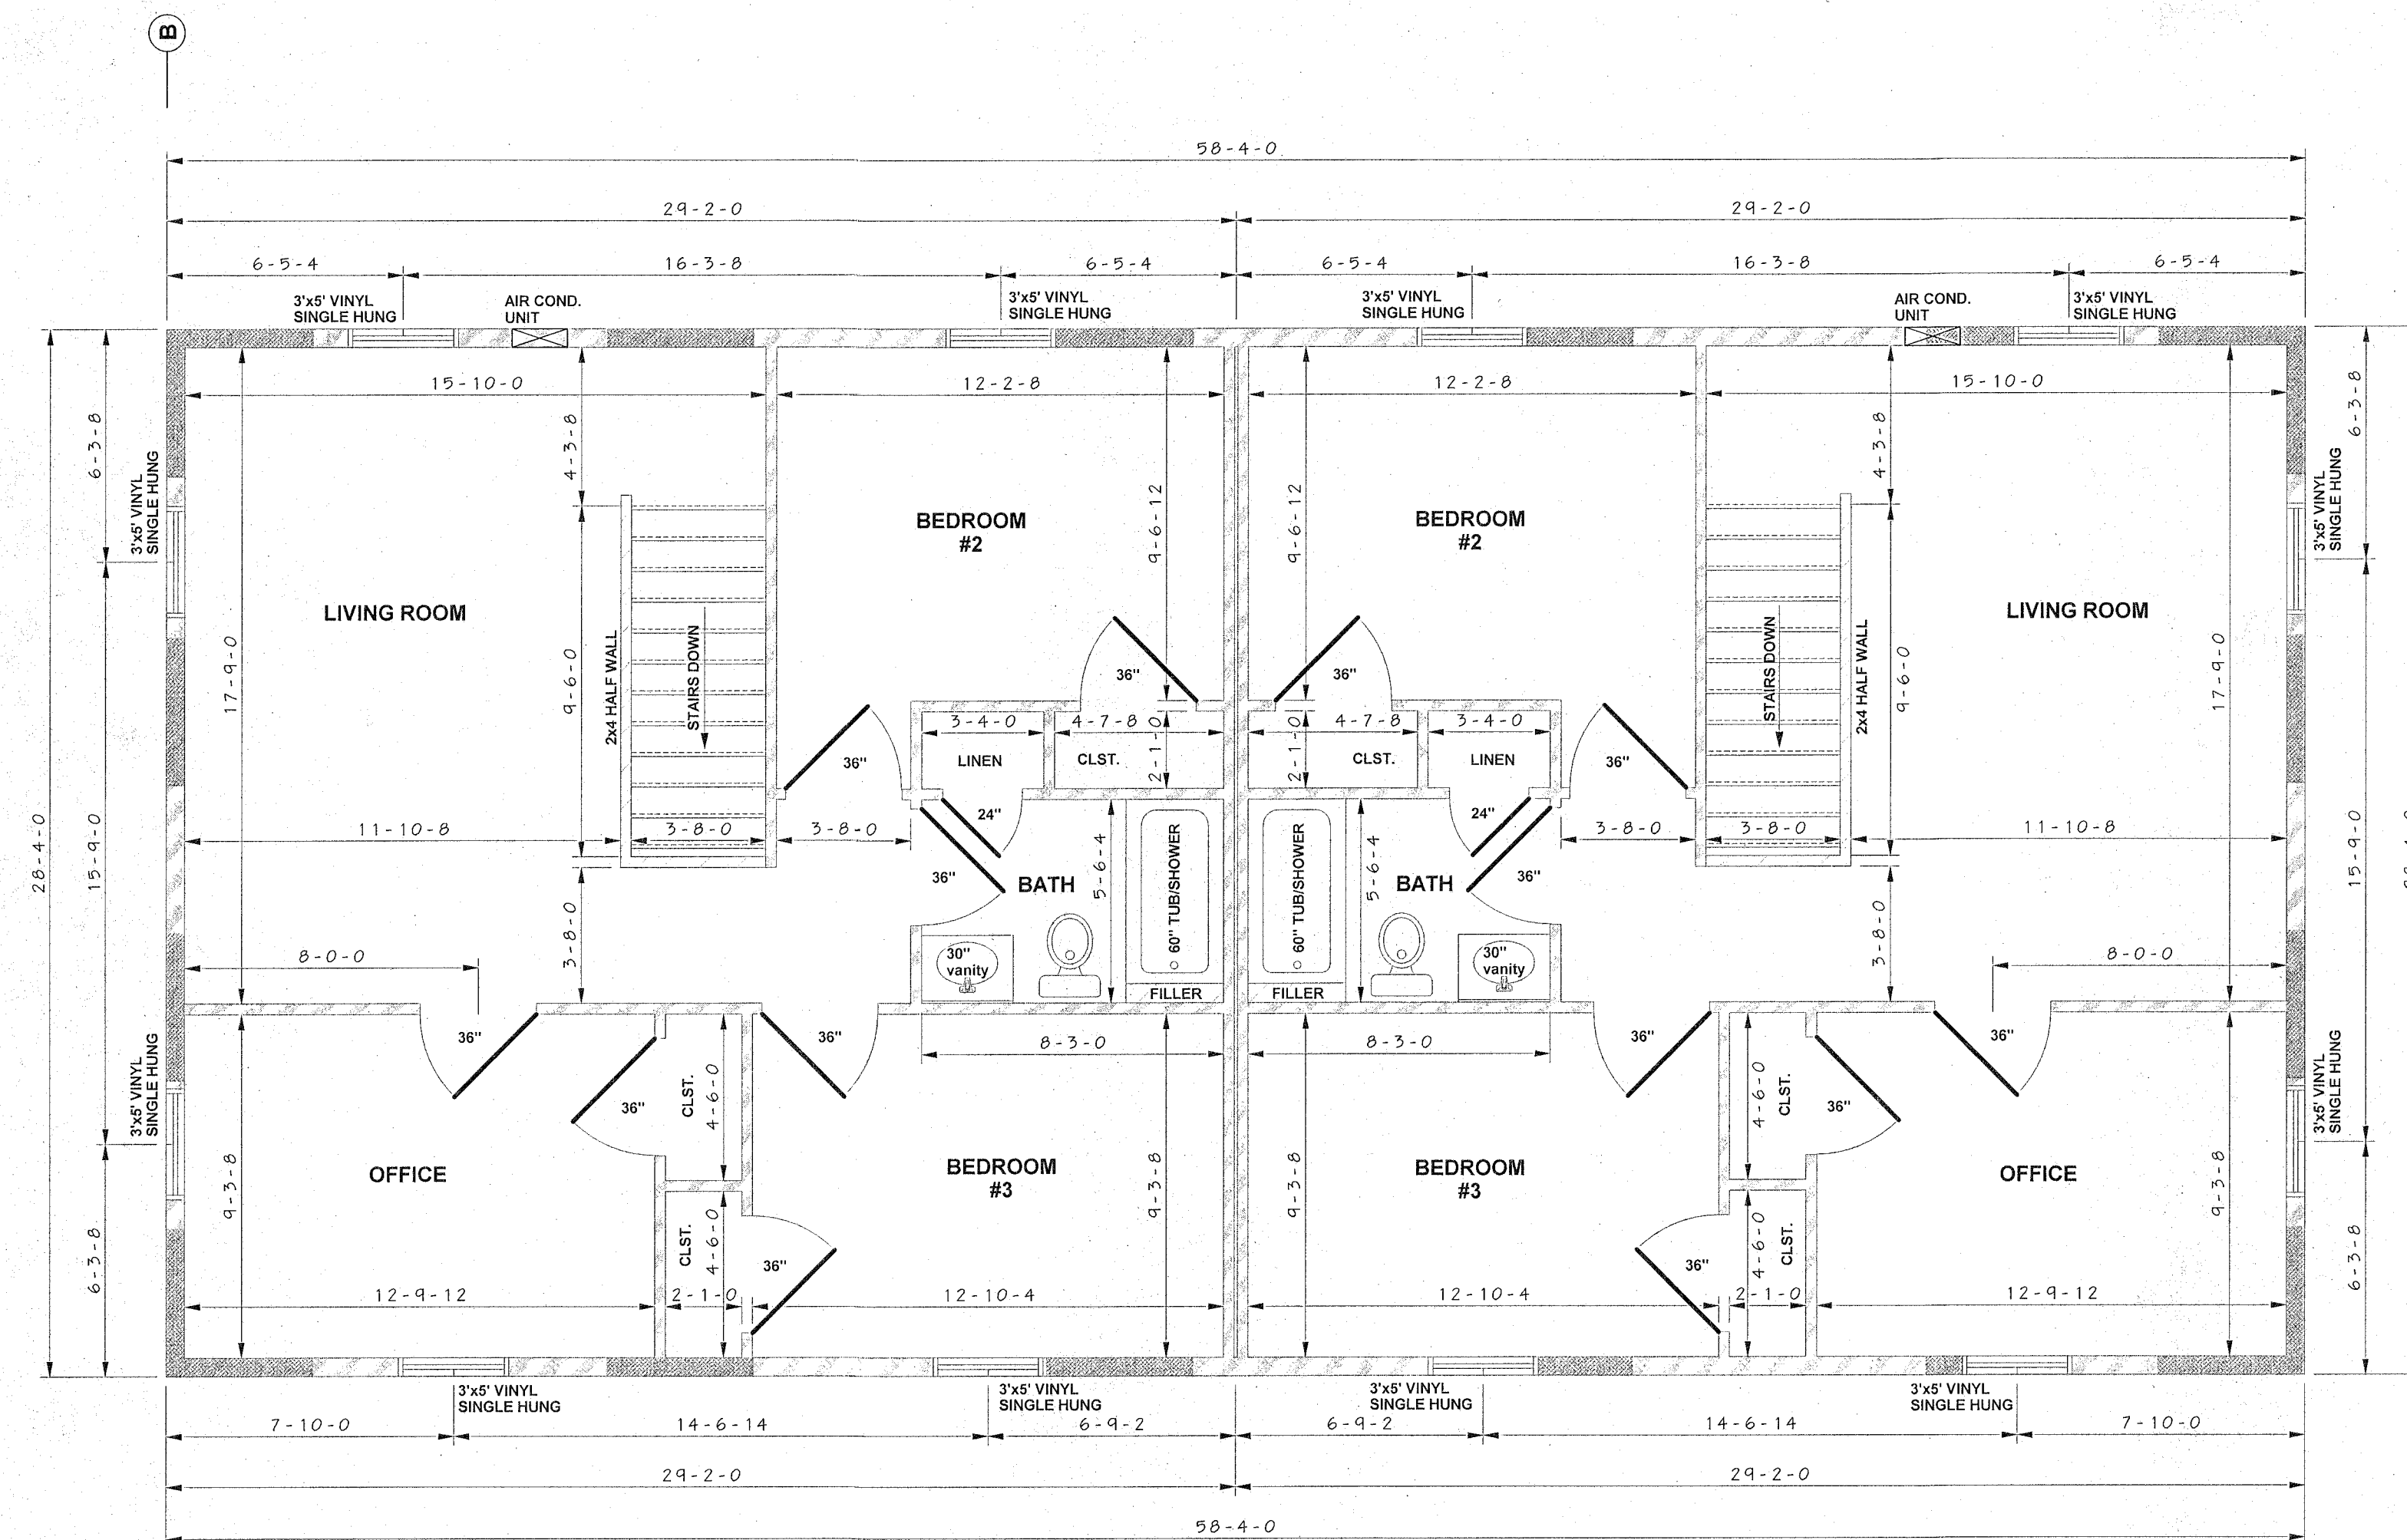

## 2/ND FLOOR PLAN

SCALE : 1/4" = 1'-0" (824 SQ. FT. PER SIDE)

○ SPECIFIES BRACED  
WALL LINES.  
■ SPECIFIES BRACED WALL  
PANELS.

COMM. 21.25 (b) (6)  
(A) WOOD STRUCTURAL PANEL SHEATHING  
WITH ALL EDGES FASTENED TO FRAMING  
OR BLOCKING IN ACCORDANCE WITH THE  
FASTENER TABLE IN THE APPENDIX AND NOT LESS THAN  
3/8" THICK FOR 16" STUD SPACING AND NOT  
LESS THAN 7/16" THICK FOR 24" STUD SPACING.  
(B) GYPSUM BOARD WITH MINIMUM 1/2" THICKNESS  
PLACED ON STUDS SPACED A MAXIMUM OF 24" O.C.  
AND FASTENED AT PANEL EDGES INCLUDING TOP AND  
BOTTOM PLATES AT 7" O.C. WITH THE SIZE NAILS SPECIFIED  
IN THE FASTENER TABLE IN THE APPENDIX.

NOTE: REFER TO THE  
WISCONSIN (UDC) COMM. 21.25  
FOR THE COMPLETE UNDERSTANDING  
OF THE BRACED WALL CODE.

**WOODLAND  
DESIGNS**  
JOB: S & S FRAMING  
DUPLEX  
page 4 of 7

