


**33RD ST. S, LA CROSSE.
REPLACE FAULTED
STREET LIGHT CABLE.**



DIRECTIONAL BORE 1-1/2" RED PE PIPE, (250'). PULL IN # 6 DUPLEX. INSTALL CURRENT LIMITING FUSE IN TRANSFORMER. ABANDON THE EXISTING STREET LIGHT CABLE.

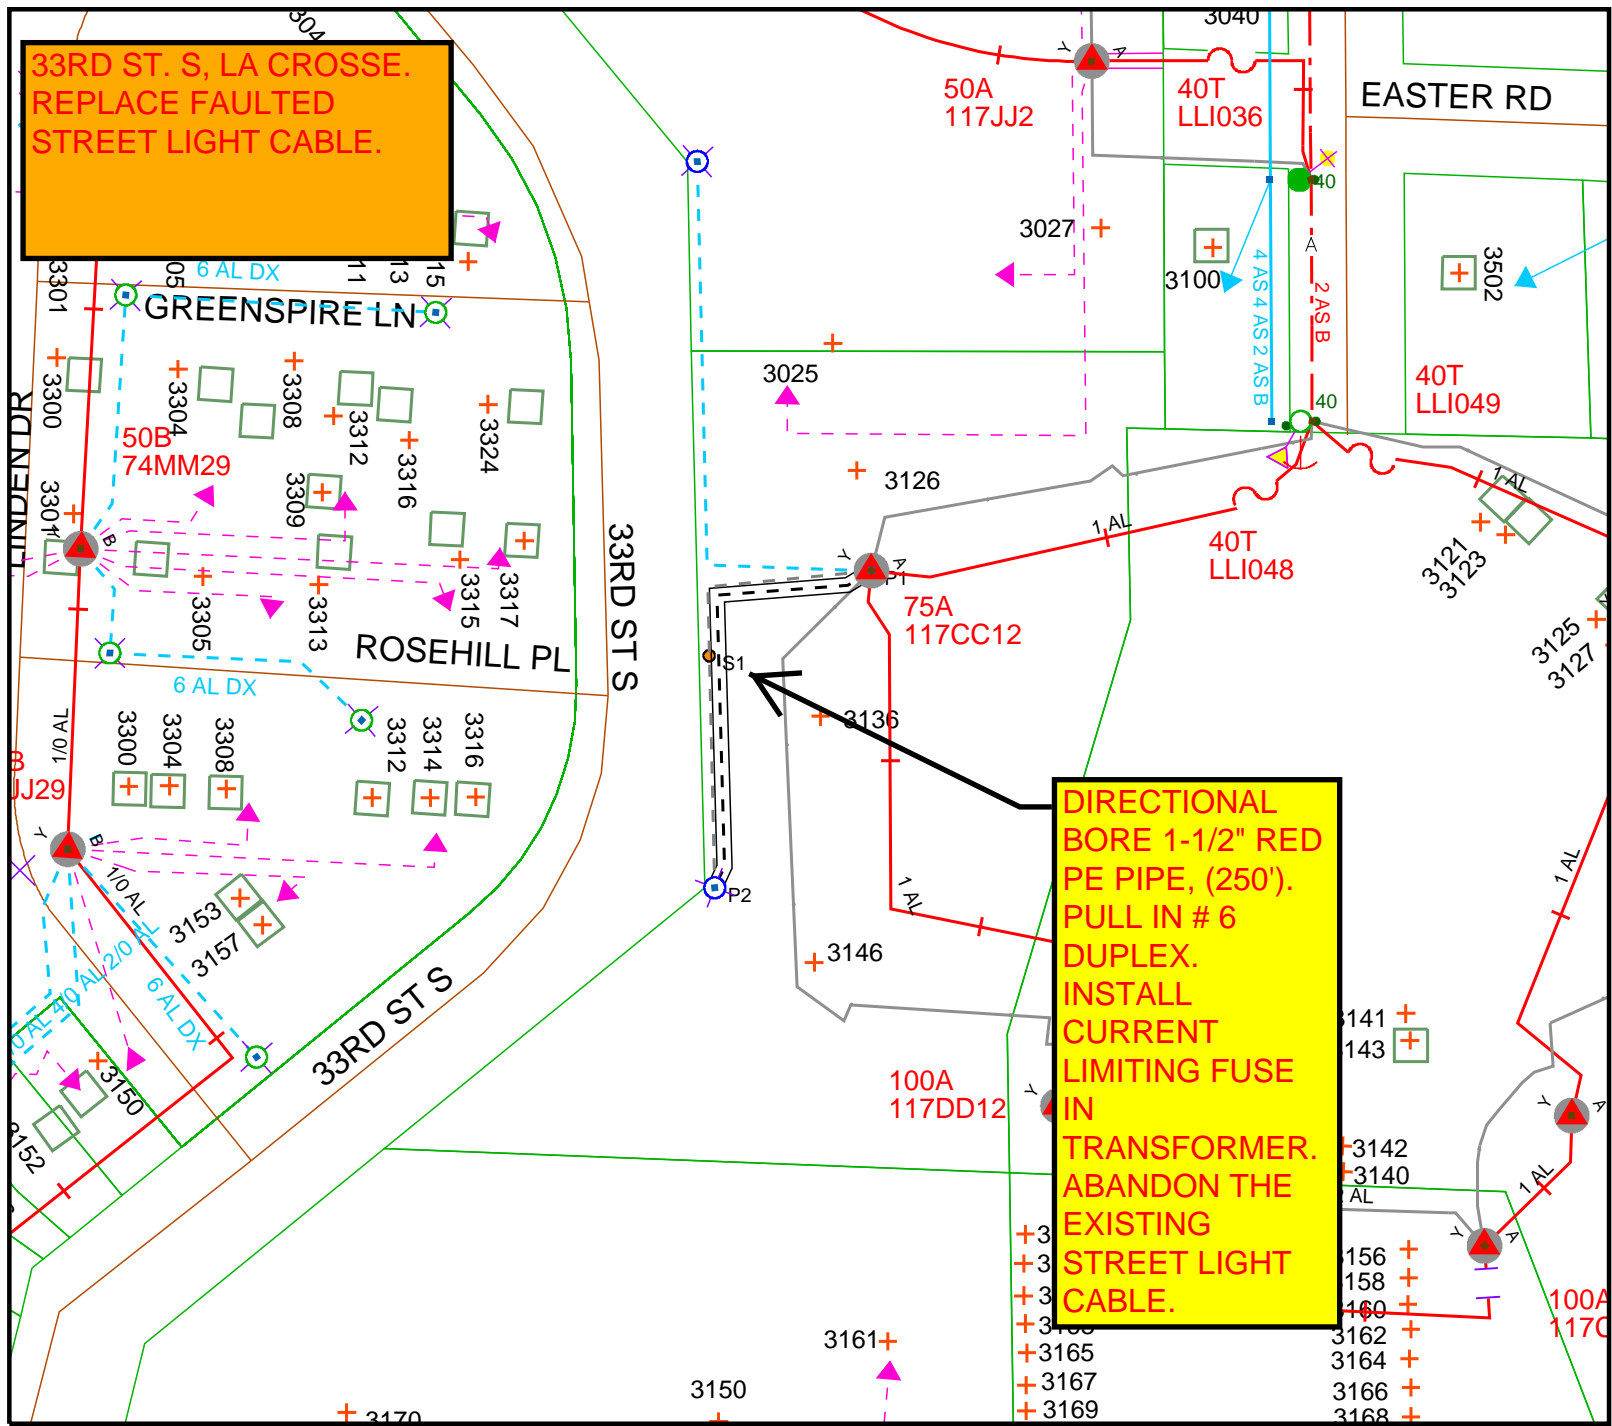

**DESIGNER:
SCOTT R.
608-789-3625**

Work Order Information	
Service Request # :	
Design Number :	00000831550
Designer/Planner ID :	w75081
Designer/Planner Name :	Roberts, Scott
Designer/Planner Ph # :	
Manager Approval :	
Joint Utility	
E:	G:
T:	C:
Design Location	
Division :	La Crosse
County :	La Crosse
City :	LA CROSSE
Address:	
T:	15N R: 7W S: 15
Map #:	1647650 WIS Permit
Electric	
Feeder:	Voltage:
Phase:	BkupDevID:
Gas	
System:	Pressure:
Size :	Material :
Dead End :	
Work Order # :	
Date:	11/30/2018
Sketch:	# of # Sketch Data
Scale:	1" equals 100'
<small>CONSTRUCTION USE ONLY</small> <input type="checkbox"/> NO CHANGES (BUILT AS DESIGNED) <input type="checkbox"/> CHANGES MADE AS INDICATED <small>(ALL URD MUST HAVE ACTUAL MEASUREMENTS FROM THE FIELD SITE)</small>	
RFO:	
FOREMAN:	DATE:
TEAM LEADER:	

DISCLAIMER: THERE ARE NO REPRESENTATIONS OR WARRANTIES (EXPRESS OR IMPLIED) ABOUT THE ACCURACY OF THIS PRINT. THIS PRINT IS PROVIDED WITH NO CLAIM AS TO PRINT COMPLETENESS, TIMELINESS, ACCURACY OF CONTENT OR USEFULNESS. STATE LAW REQUIRES ANYONE DIGGING, GRADING OR EXCAVATING TO OBTAIN A PRIOR FIELD LOCATE OF ALL UTILITIES; THIS PRINT DOES NOT DISCHARGE THIS REQUIREMENT OR ANY OTHER REQUIREMENT. THE COMPANY AND ITS AFFILIATES ASSUME NO LEGAL RESPONSIBILITY OR LIABILITY FOR THE RECIPIENT'S USE (OR ANY OTHER PARTIES' USE) OF THE PRINT, INCLUDING THE RECIPIENTS INTENDED PURPOSE IN USING THE PRINT. NO COMPANY EMPLOYEE OR OTHER PARTY HAS BEEN AUTHORIZED TO PROVIDE THIS PRINT FOR PLANNING OR ESTIMATING PURPOSES; RELY ON THIS PRINT AT YOUR OWN RISK. BY ACCEPTING THIS PRINT, THE RECIPIENT & ANY OTHER PARTY RECEIVING A COPY OF THE PRINT ACKNOWLEDGES AND AGREES TO THIS DISCLAIMER.
For All Field Locates Call 811