


Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
CalcPts_1	Illuminance	Fc	0.11	7.5	0.0	N.A.	N.A.
Parking Lot	Illuminance	Fc	1.70	7.2	0.5	3.40	14.40

Luminaire Schedule								
Symbol	Qty	Label	Tag	Description	Arrangement	LLF	Luminaire Lumens	Luminaire Watts
	5	WF6 ALO20 SWW5 90CRI MVOLT 40	RW6	WF6 ALO20 SWW5 90CRI MVOLT 40K	Single	0.900	1360	15
	6	slim17fa15adj_4k	W15	SLIM17FA15ADJ_4K	Single	0.900	1761	13.98
	2	PRV-C25-D-UNV-T3-BZ-HSS	Y13H	PRV-C25-D-UNV-T3-BZ-HSS type 3 distribution on 20ft pole on 2.5ft base	Single	0.900	11975	96
	3	PRV-C25-D-UNV-T4-BZ-HSS	Y14H	PRV-C25-D-UNV-T4-BZ-HSS type 4 distribution on 20ft pole on 2.5ft base	Single	0.900	11933	96



1. STANDARD REFLECTANCE OF 80/50/20 UNLESS NOTED OTHERWISE.
2. NOT A CONSTRUCTION DOCUMENT- FOR DESIGN PURPOSES ONLY.
3. STANDARD INDOOR CALC POINTS @ 30" AFF UNLESS NOTED OTHERWISE.
4. STANDARD OUTDOOR CALC POINTS @ GRADE UNLESS NOTED OTHERWISE.
5. EGRESS CALC POINTS @ 0'-0" AFF.
6. PHOTOMETRICS ARE ESTIMATED LIGHTING CALCULATIONS.
VIKING ELECTRIC ASSUMES NO RESPONSIBILITY FOR INSTALLED LIGHT LEVELS DUE TO FIELD CONDITIONS.
7. VIKING ELECTRIC NOT RESPONSIBLE FOR FINAL REVIEW OF CODE REQUIREMENTS.

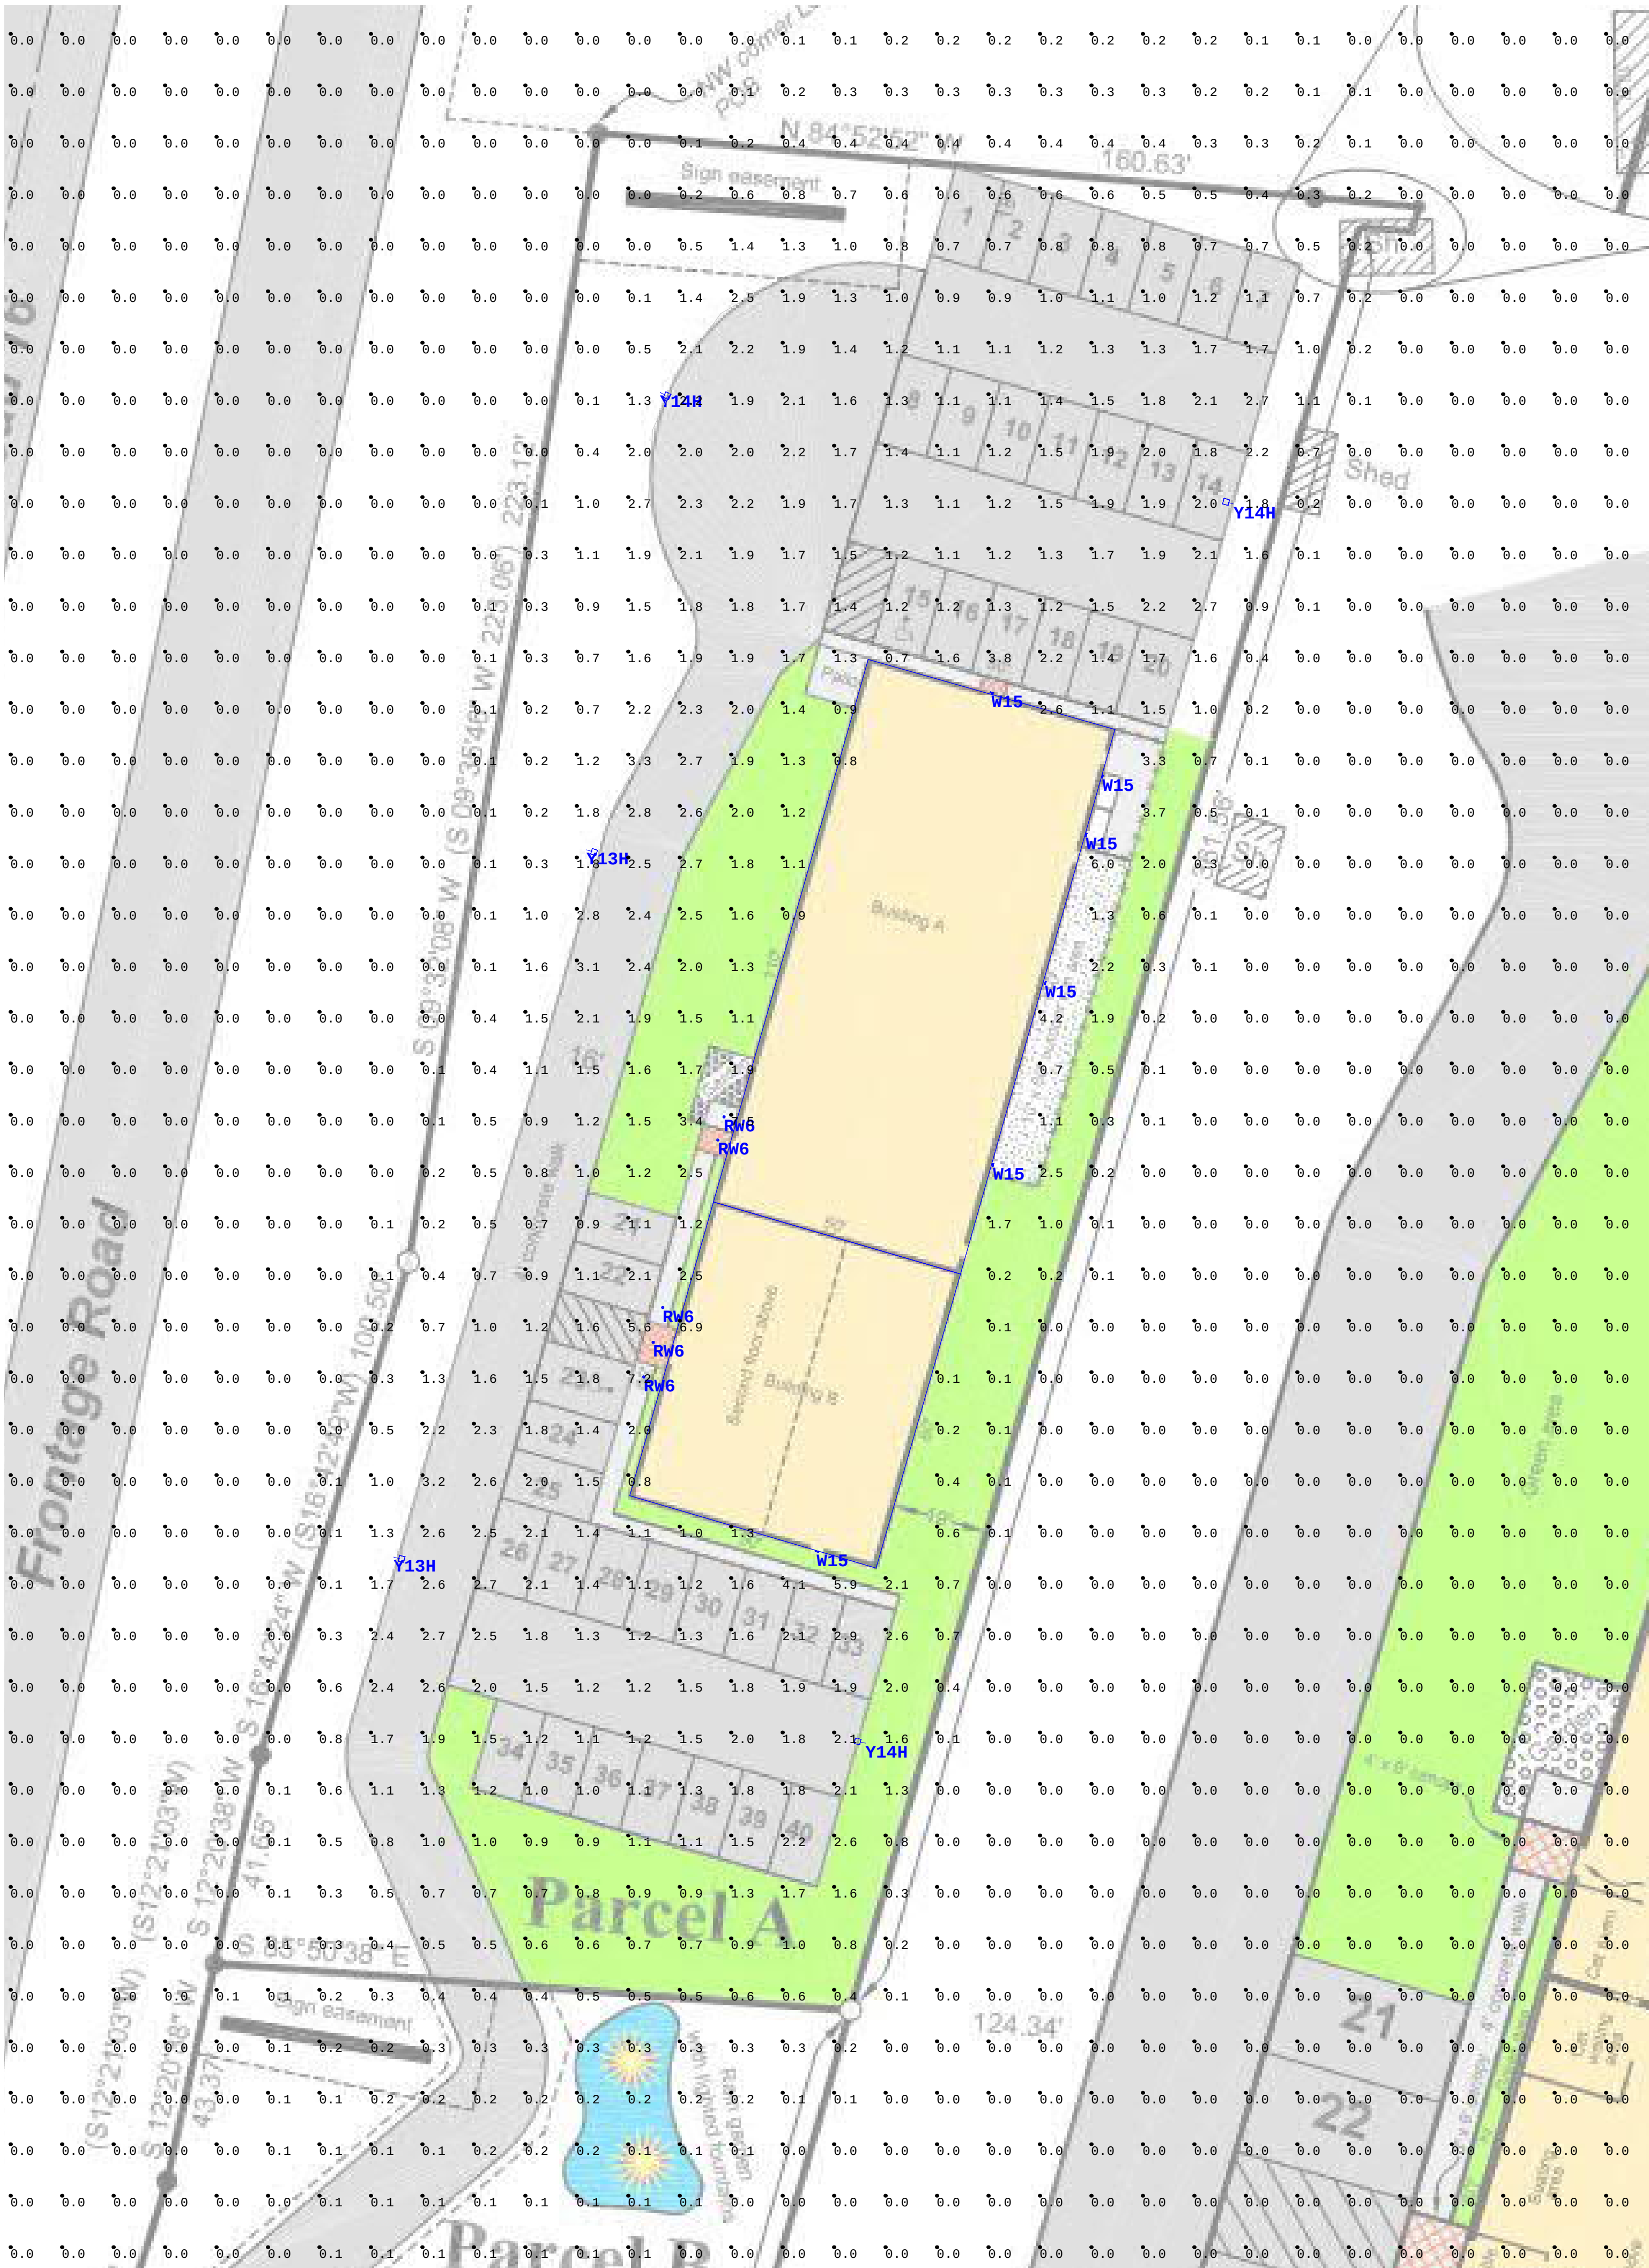

Drawn By: JB
Project #: 154518
Date: 5/2/2025

PHOTOMETRIC SITE PLAN
LA CROSE VETERINARY CLINIC