

PROJECT

**MAYO EMPLOYEES
 FEDERAL CREDIT UNION**

NEW BUILDING

605 WEST AVE S.
 LA CROSSE, WI

ISSUED SET 3/27/26

REVISIONS

DATE NO

SEAN C. RABOIN

47337 3/27/26

Reg No. Date

**NOT FOR
 CONSTRUCTION
 PRELIMINARY**

ROOF PLAN

Drawn By: SRC


Checked By: RBB

251167


COPYRIGHT © HTG ARCHITECTS

GENERAL NOTES:	
<p>MAIN BUILDING ROOF - EPDM. ON 1/4" PER FT. FLOPING TAPERED INSULATION ON 4 1/2" RIGID INSUL. BASE LAYER ON 1 1/2" MTL. DECKING ON FLAT STL. STRUCTURE (SEE STRUCT.)</p> <p>ENTRY CANOPY/DRIVE-UP CANOPY - EPDM. ON 1/4" PER FOOT SLOPING TOP LAYER OF RIGID INSUL. ON 1 1/2" MTL. DECKING ON FLAT STRUCTURE (SEE STRUCT.)</p> <p>CLERESTORY ROOF - EPDM. ON 1/4" PER FT. SLOPING TAPERED INSULATION ON 4 1/2" RIGID INSUL. BASE LAYER ON 1 1/2" MTL. DECKING ON FLAT STL. STRUCTURE (SEE STRUCT.)</p>	<p>MISCELLANEOUS NOTES - FULLY ADHERE EPDM. TO ALL PARAPETS- TYPICAL.</p> <p>EPDM. TO BE ADHERED & MECH. FASTENED TO DECK (SEE SPEC.)</p> <p>SEE MECHANICAL FOR EXACT QUANTITIES & LOCATIONS OF ROOF & OVERFLOW DRAINS.</p> <p>INSTALL CRICKETS AS REQ'D. FOR PROPER ROOF DRAINAGE.</p>
<p>● 55 THICKNESS (IN INCHES) OF TAPERED INSULATION.</p> <p>R.D. ROOF DRAIN (SEE MECH.)</p> <p>O.D. OVERFLOW ROOF DRAIN (SEE MECH.) OVERFLOW DRAIN TO BE MAX. 2' ABOVE ROOF DRAIN.</p>	


- LOCATIONS OF ALL ROOF PENETRATIONS TO BE VERIFIED WITH APPROPRIATE SUBCONTRACTOR.
- VERIFY EXACT LOCATIONS OF ROOFTOP CURBS WITH STRUCTURAL ENGINEER PRIOR TO COMMENCING WORK.
- INSTALL RIGID INSULATION CRICKETS AT HIGH SIDE OF ALL RTU'S AND ROOF HATCH. SLOPE 1/4" PER FOOT.
- PROVIDE PIPE FLASHINGS, CONDUIT FLASHINGS, AND MANUFACTURED GAS PIPING SUPPORTS AS REQUIRED. REFER TO TYPICAL DETAILS ON A1.3 AND MANUFACTURERS DETAILS TO MEET WARRANTY OF ROOF.
- PROVIDE STRUCTURAL FRAMING AT ALL ROOF OPENINGS. REFER TO STRUCTURAL DRAWINGS.
- CONTRACTOR SHALL KEEP ROOF CLEAN OF ALL DEBRIS DURING ALL CONSTRUCTION WORK.
- REFER TO DESIGN/BUILD PLUMBING DRAWINGS, MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL ROOF PENETRATIONS REQUIRING ROOF FLASHING WORK. ALL ROOF PENETRATIONS FOR MINOR ROOF VENTS AND SIMILAR ITEMS MAY NOT BE INDICATED ON THIS ROOF PLAN. HOWEVER, ALL ROOF FLASHING WORK SHALL BE PROVIDED BY THE ROOFING SUBCONTRACTOR SO AS TO OBTAIN OR MAINTAIN NEW ROOFING WARRANTIES.
- ROOF DRAIN (SEE MECH.)

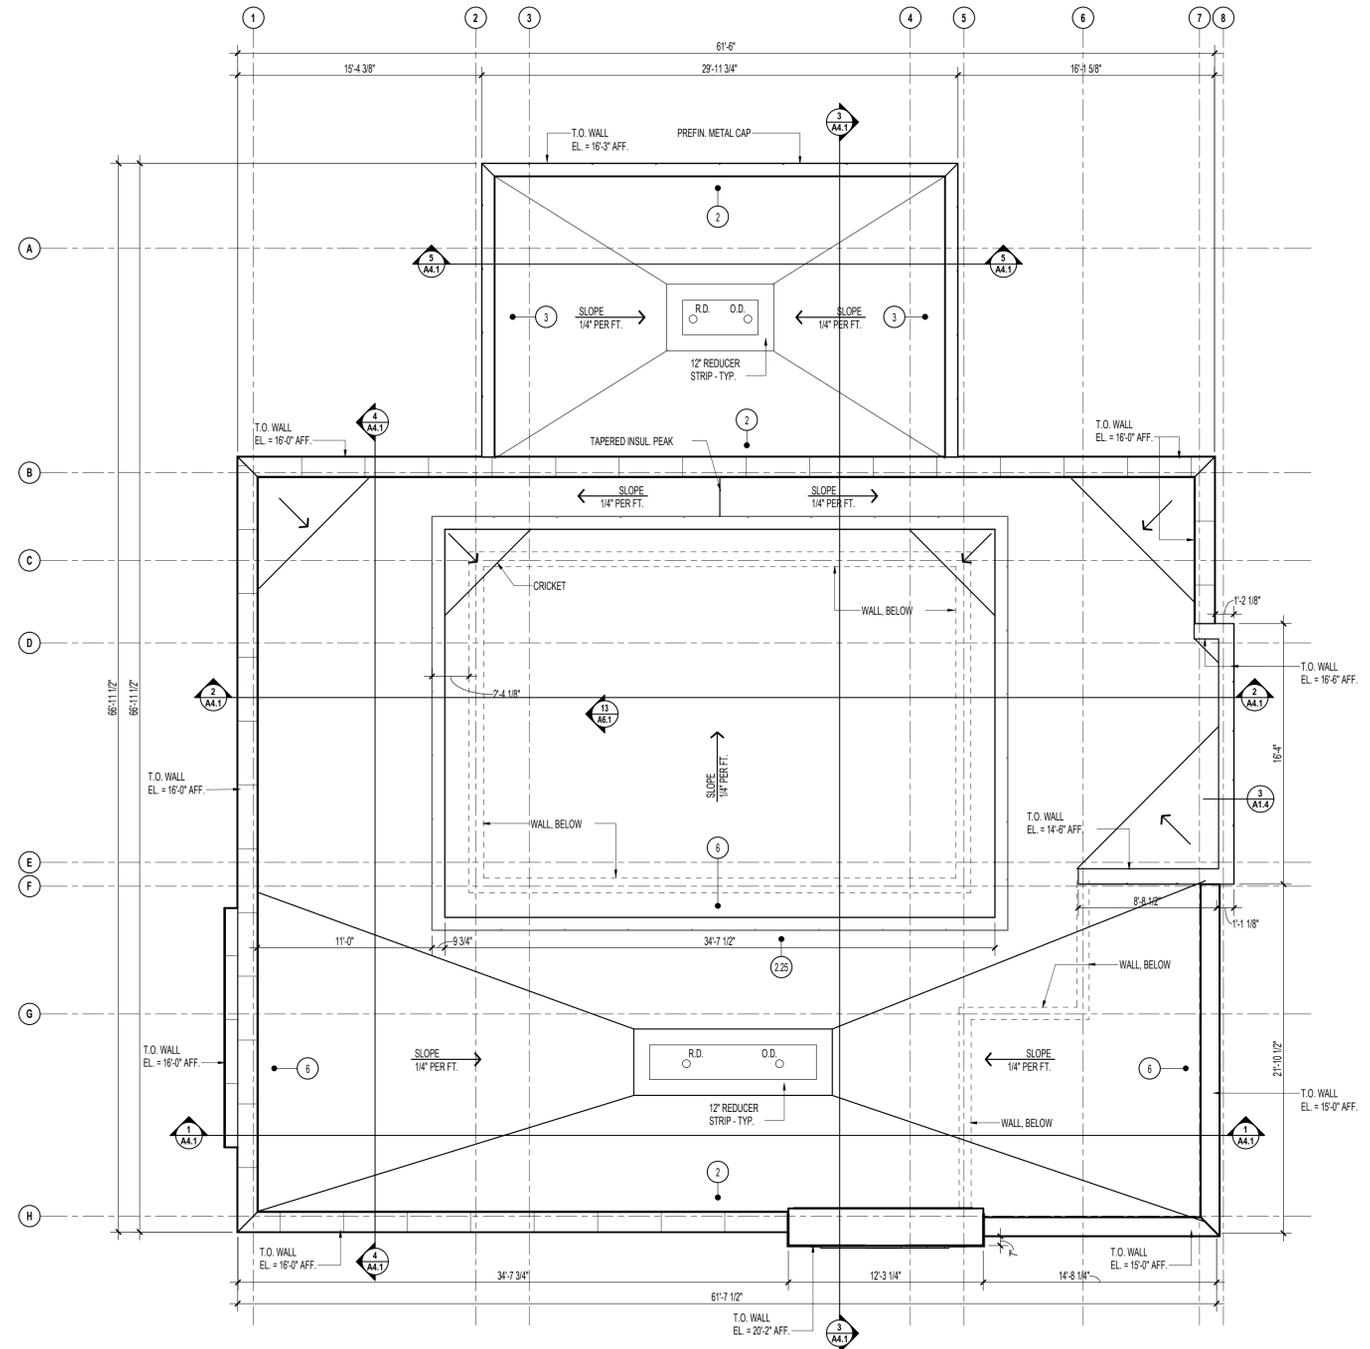

1
A1.3 ROOF PLAN
 316' x 114'





A1.3

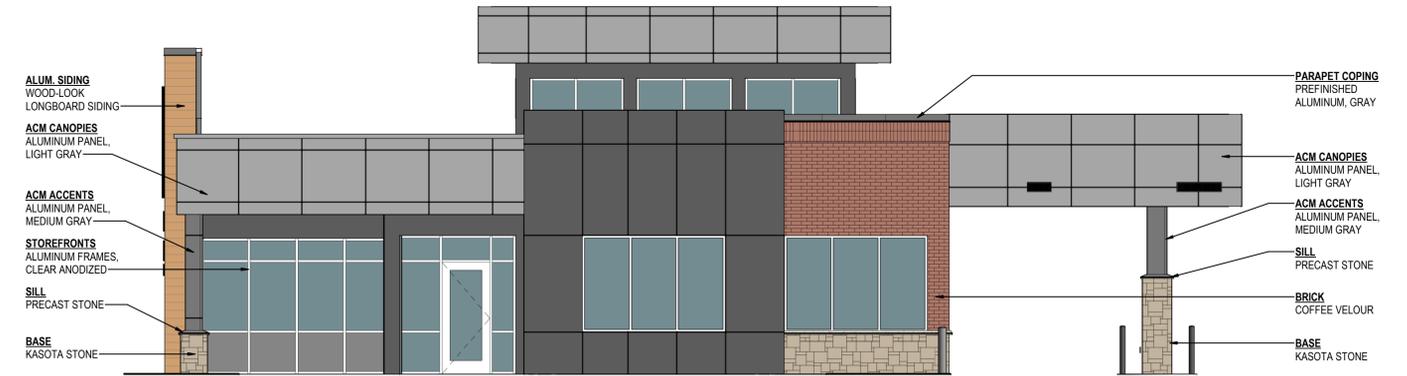

1 OPTION A - EXTERIOR ELEVATION - WEST
3/16" = 1'-0"

2 OPTION A - EXTERIOR ELEVATION - SOUTH
3/16" = 1'-0"

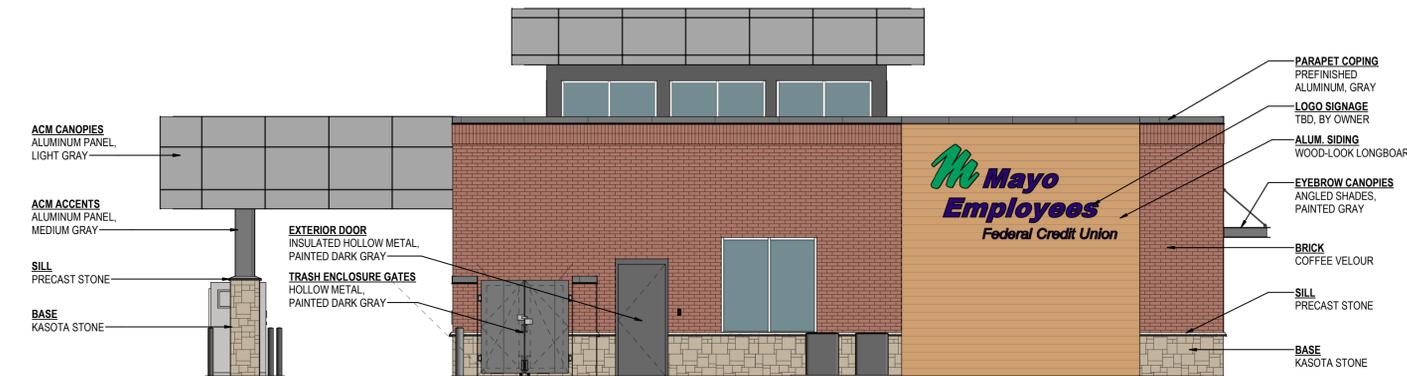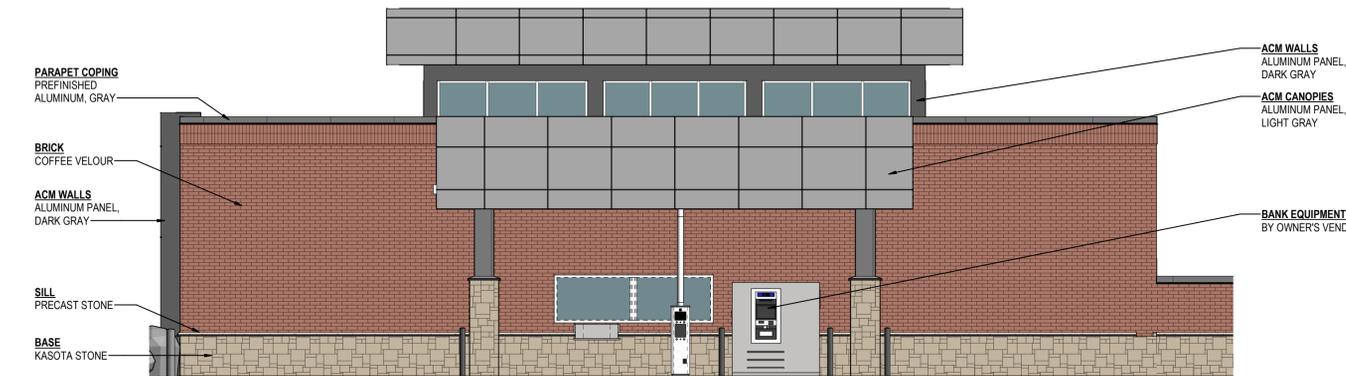

3 OPTION A - EXTERIOR ELEVATION - EAST
3/16" = 1'-0"

4 OPTION A - EXTERIOR ELEVATION - NORTH
3/16" = 1'-0"

PROJECT

MAYO EMPLOYEES FEDERAL CREDIT UNION


NEW BUILDING

605 WEST AVE S. LA CROSSE, WI


ISSUED SET 3/27/26

REVISIONS


DATE NO

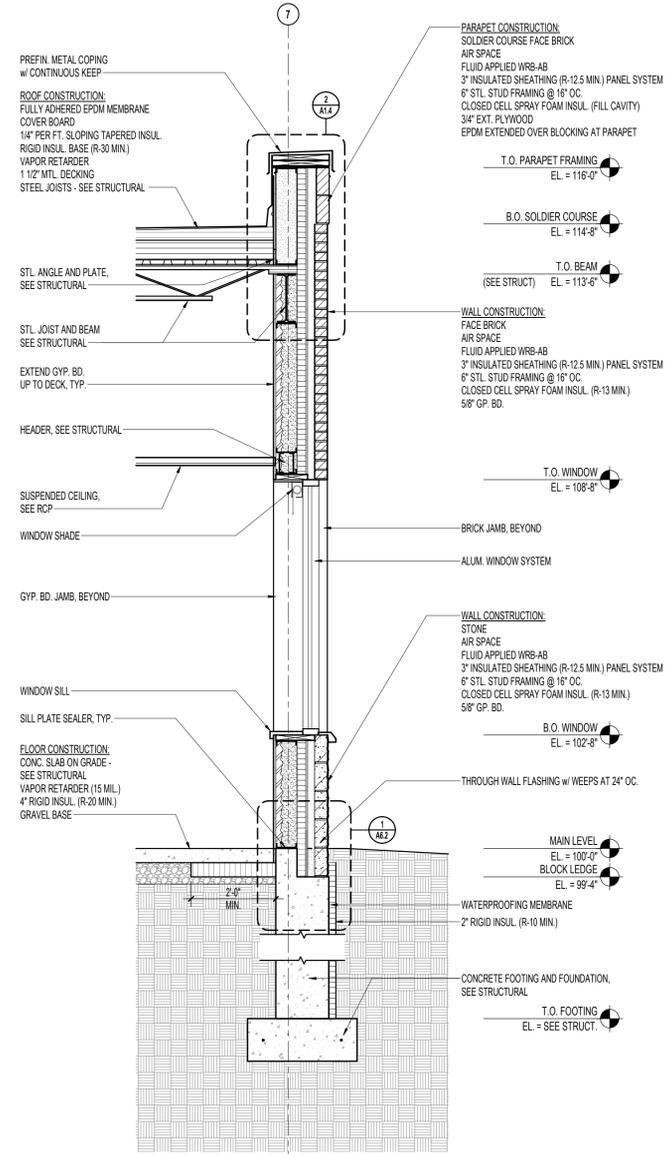

3
A5.1 WALL SECTION, WINDOW
 1/2" = 1'-0"

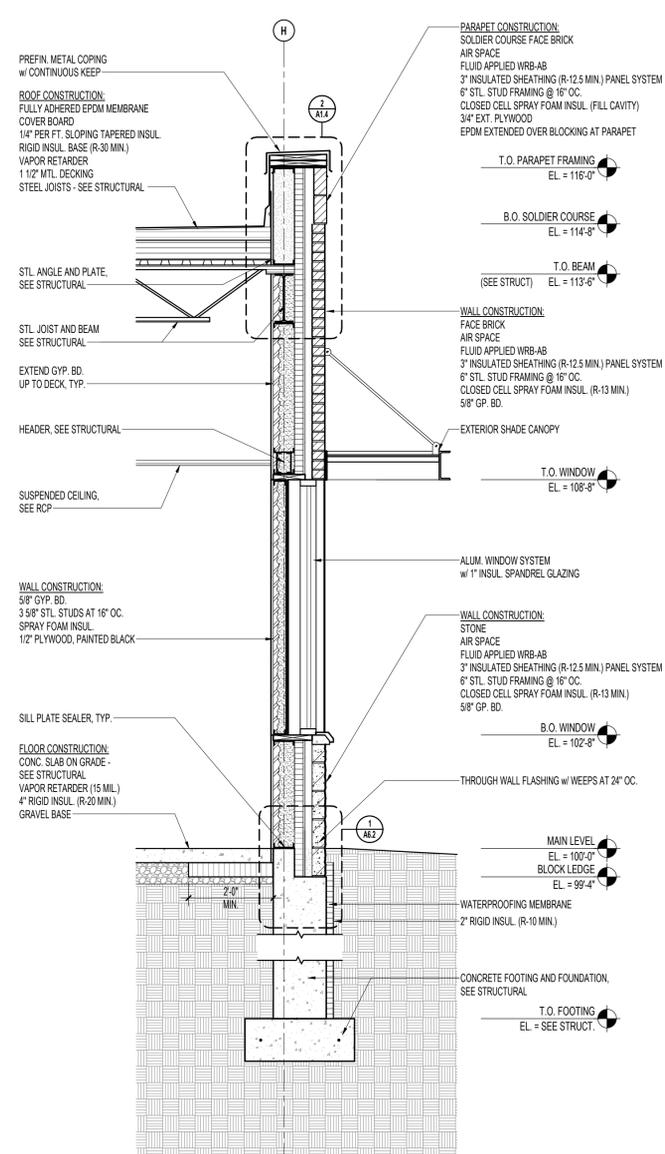

2
A5.1 WALL SECTION, WINDOW, SPANDREL
 1/2" = 1'-0"

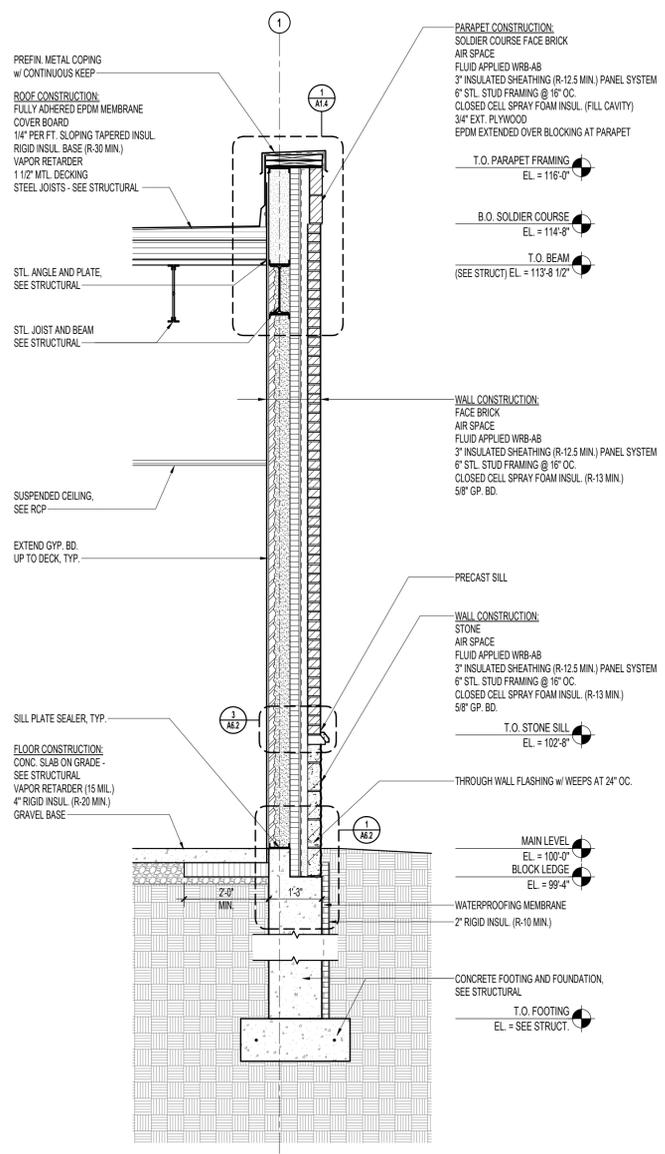

1
A5.1 WALL SECTION, TYP.
 1/2" = 1'-0"

Autodesk Docs\Mayo Employees FCU\La Crosse\W251167_Arch_Centim_125.rvt
 3/27/26 2:38:58 PM

Drawn By: SRC Checked By: SCR

A5.1

